


M:\STANDARD SPECS & DETAILS\2019\Detail\Plates\SER-2 WATER SERVICE FOR REPLACEMENT PROJECTS.dwg

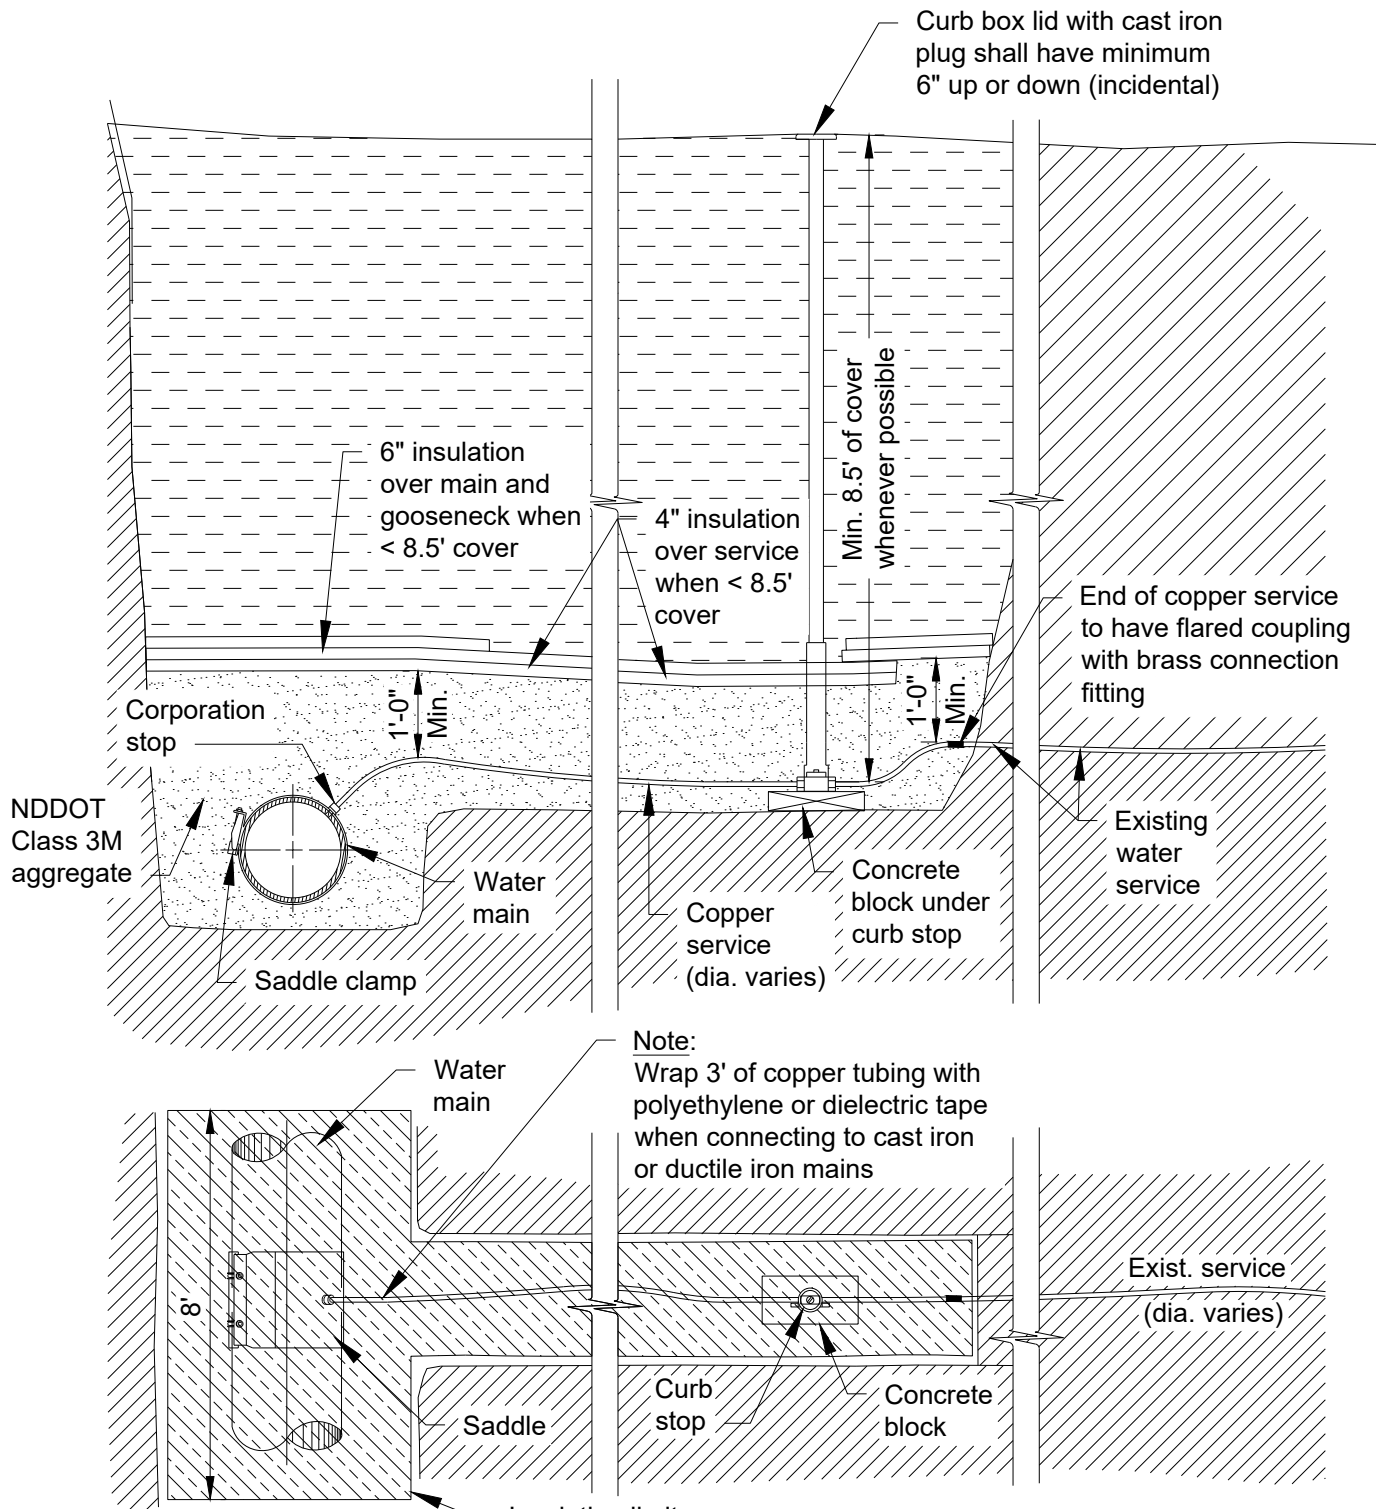

Note:
 Wrap 3' of copper tubing with polyethylene or dielectric tape when connecting to cast iron or ductile iron mains

Notes:

1. Curb stop to be placed on a concrete block.
2. All insulation boards shall be 2" thick, stacked to achieve total thickness desired.
3. When stacking insulation boards, stagger each layer such that all butt joints are overlapped by the layer above.

City Plate No.: SER-2
Last Revision: 11/13/2019
File: SER_2.dwg

**STANDARD DETAILS
 WATER SERVICE FOR
 REPLACEMENT PROJECTS**

