



### CONNECTION OPTION "B"

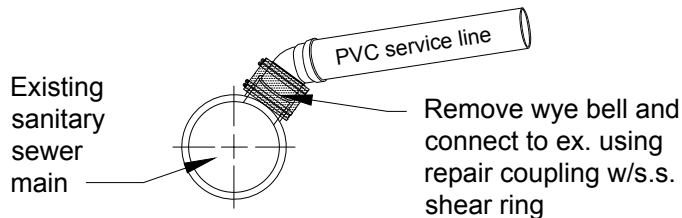

### CONNECTION OPTION "C"

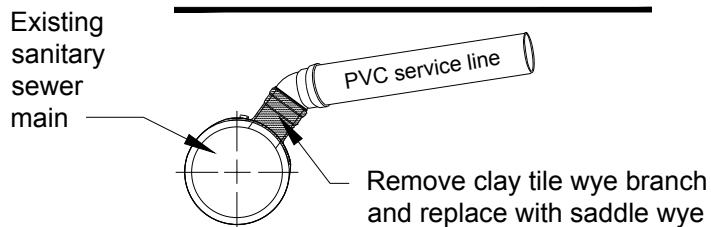

#### Notes:

1. Insulation required where service is less than 8.5' deep.
2. Use connection option "A" if ex. wye bell is good, "B" when ex. wye bell is broken & "C" when ex. wye is broken down to the main.
3. Pipes shall be butted together with repair coupling centered on butt-joint.

City Plate No.:  
SER-5

Last Revision:  
4/11/2019

File:  
SER\_5.dwg

**STANDARD DETAILS  
WATER SERVICE FOR  
REPLACEMENT PROJECTS**

**City of Minot**  
ENGINEERING DEPARTMENT