


Neenah frost-proof frame and Type B cover or equal, lettered "WATER" with 2 concealed pick holes Type F. Casting shall be sized large enough to remove meter assembly without disassembling.

PLAN

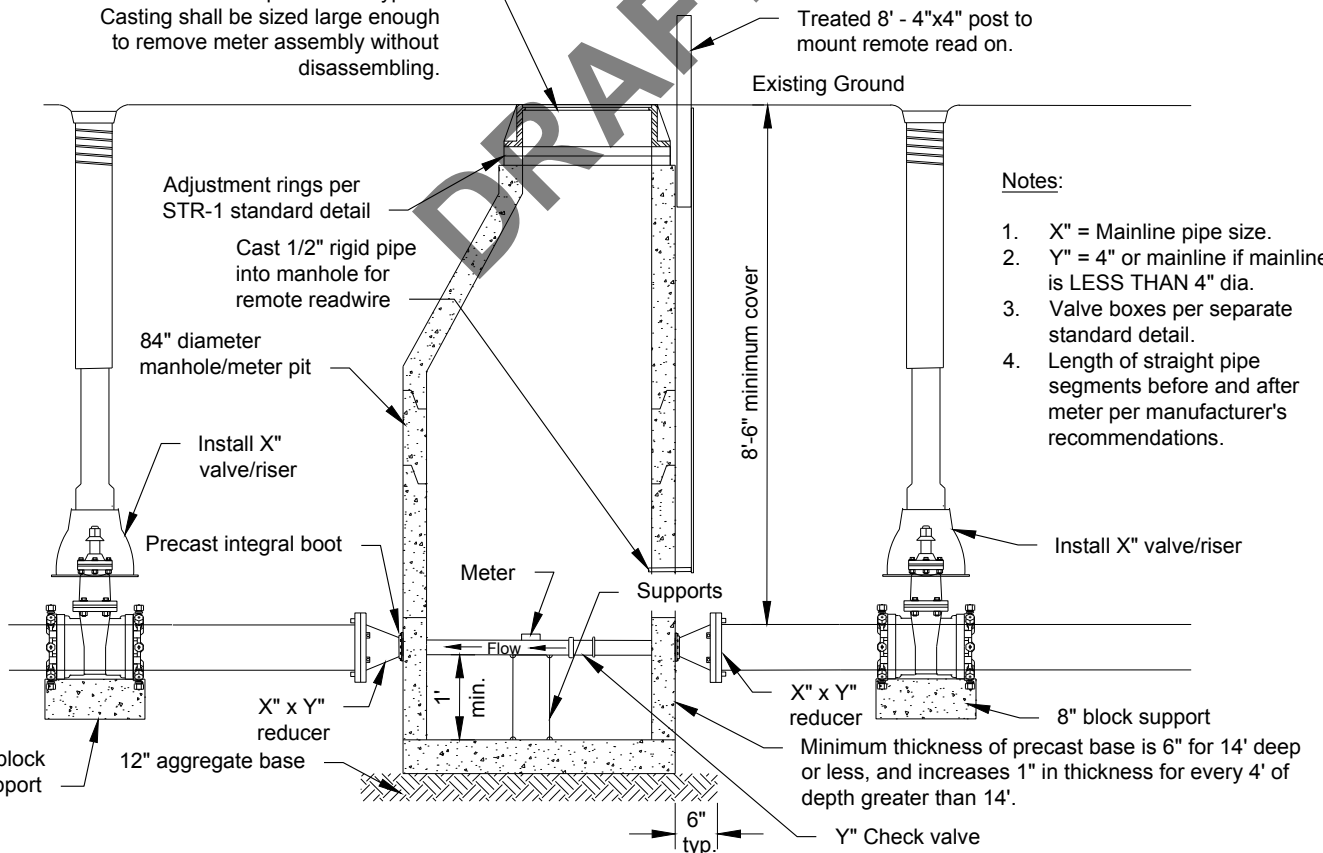

Notes:

1. X" = Mainline pipe size.
2. Y" = 4" or mainline if mainline is LESS THAN 4" dia.
3. Valve boxes per separate standard detail.
4. Length of straight pipe segments before and after meter per manufacturer's recommendations.

SECTION A-A

C:\Users\staskcard\Desktop\MINOT DETAIL\STR-8 PEDESTRIAN CURB RAMP PATHWAY-SIDEWALK.dwg

City Plate No.:
WAT-6A
Last Revision:
4/11/2019
File:
WAT_6A.dwg

**STANDARD DETAILS
METER PIT
UP TO 4"**

City of Minot
ENGINEERING DEPARTMENT