



**Notes:**

1. 8.5' minimum cover required over top of water main.
2. All tapping gate valves shall be straight flange by MJ flange.
3. Gave valve box per separate standard detail.
4. All water main taps shall only be operated by Public Works Staff; Contractor must contact the Water and Sewer Superintendent.

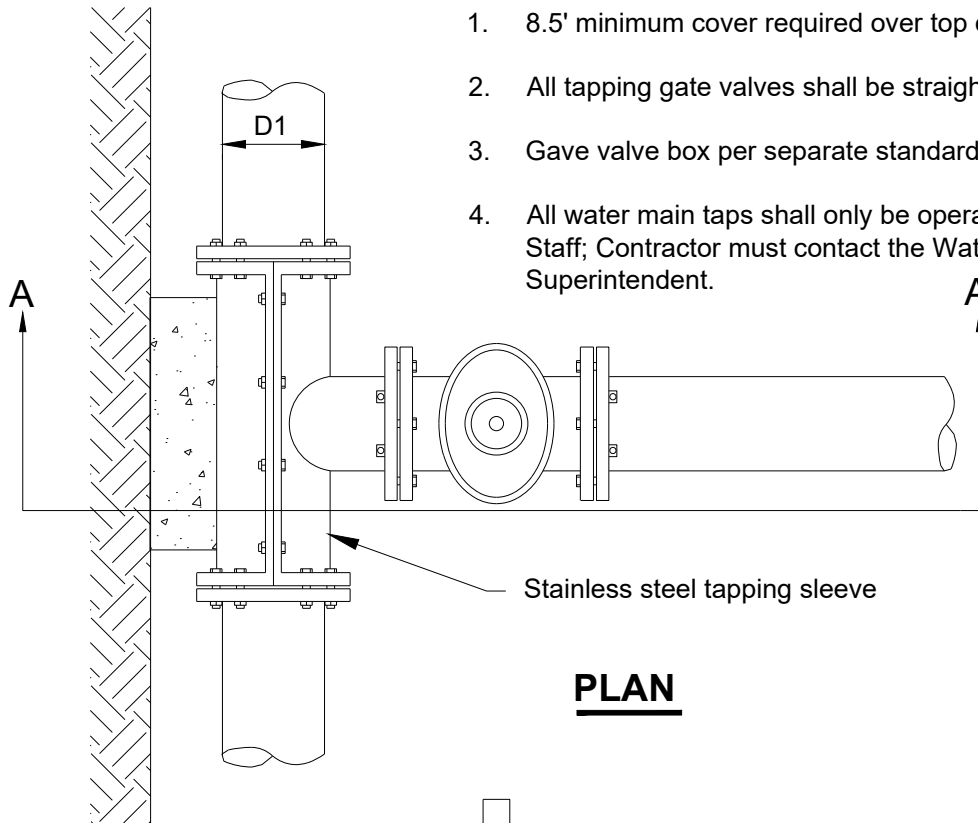

**PLAN**

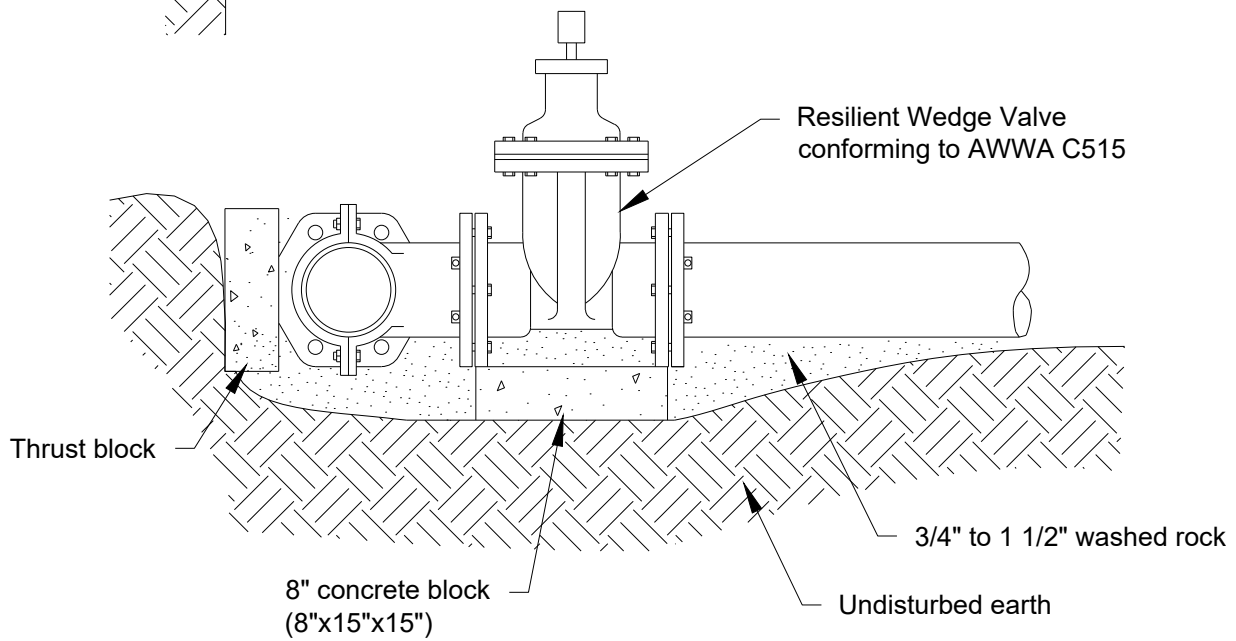

**SECTION A-A**

MASTANDARD SPECS & DETAILS\2021\Detail\WAT-5 WATERMAIN WET TAP.dwg

City Plate No.:  
WAT-5  
Last Revision:  
12/18/2020  
Section:  
2100

**STANDARD DETAILS  
WATER MAIN  
WET TAP**

